




## PRODUCT EVALUATION REPORT

Artisan L-12 Panel

State of Florida Professional Engineer:  
Terrence E. Wolfe, P.E. # 44923  
19530 Ramblewood Drive  
Humble, TX 77338

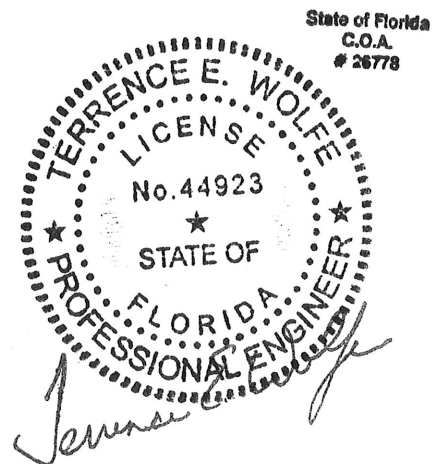

MAR 30 2015

**Manufacturer:**

**MBCI, L.P.** *a division of NCI, L.P.*

**Houston**

14031 West Hardy  
Houston, TX 77064

**Lubbock**

5711 FM-40  
Lubbock, TX 79401

**Oklahoma City**

7000 S. Eastern Ave.  
Oklahoma City, OK 73149

**San Antonio**

8677 I-10 East  
Converse, TX 78109

**Atlanta**

2280 Monier Ave.  
Lithia Springs, GA 30122

**Richmond**

801 South Ave.  
Colonial Heights, VA 23834

**Indianapolis**

1780 McCall Drive  
Shelbyville, IN 46176

**Omaha**

1011 Ellison Ave.  
Omaha, NE 68110

**Memphis**

300 Highway 51 North  
Hernando, MS 38632

**Rome**

6168 State Route 233  
Rome, NY 13440

**Adel**

1600 Rogers Road  
Adel, GA 31620

**Phoenix**

660 South 91<sup>st</sup> street  
Tolleson, AZ 85353

**Salt Lake City**

1155 West 2300 North  
Salt Lake City, UT 84116

**Oskaloosa**

515 13<sup>th</sup> Ave E.  
Oskaloosa, IA 52577

**Atwater**

550 Industry Way  
Atwater, CA 95301

**Ennis**


1804 Jack McKay Blvd.  
Ennis, TX 75120

**Nicholasville**

6975 Danville Rd.  
Nicholasville, KY 40340

**SUBJECT:**

State of Florida  
C.O.A.  
#26776

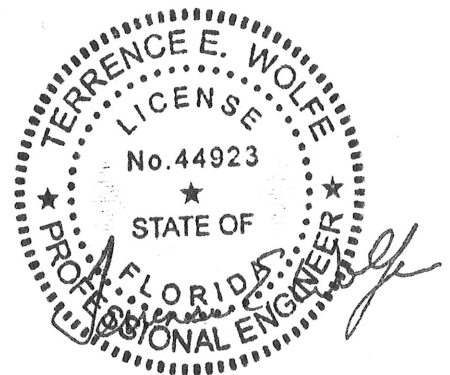

MAR 30 2015

Panel Walls, Soffits

**DESCRIPTION:**

Artisan L12 Panel – a 12"-wide, structural, metal soffit panel, available in 24-ga. (0.023"). Artisan is a concealed fastener wall system.


**CODE CRITERIA:**

**PER RULE 61G20-3, CHAPTER 14, FLORIDA BUILDING CODE – BUILDING, 5<sup>TH</sup> EDITION (2014), EXTERIOR WALLS**

**SECTION 1403  
PERFORMANCE REQUIREMENTS**

**1403.3 Structural.** Exterior walls, and the associated openings, shall be designed and constructed to resist safely the superimposed loads required by Chapter 16.

*See attached ASTM E 1592 Test Results.*

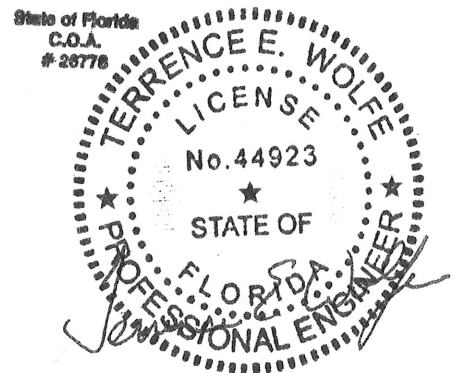

**MAR 30 2015**

## LIMITATIONS OF USE FOR NON-HIGH VELOCITY HURRICANE ZONES

**Substrate:** Steel  
**Substrate Description:** Girts or FL P.E. designed equal.  
**Substrate Attachment:** Designed by FL P.E. per FBC 5<sup>th</sup> Edition (2014).  
**Insulation:** (Optional) Vinyl or reflective foil faced fiberglass batten insulations that have a flame spread rating of not more than 25 and a smoke development rating of not more than 450.  
**Minimum Substrate Thickness:** Designed by FL P.E. and in accordance with FBC 5<sup>th</sup> Edition (2014).

### Documentation Supporting the Compliance Statement:


The product has been tested in accordance with:

- ASTM E 1592-01: Test Report 07-0271T-08 D, E and F dated 10-13-08 by Force Engineering & Testing, Inc. located in humble, TX 77338. The ASTM E 1592-01 test standard is equivalent to the ASTM E 1592-05 test standard.

**Maximum Uplift Pressure:** -85.00 psf @ 1'-0"  
-50.00 psf @ 4'-0"  
+60.00 psf @ 4'-0"


**Application:** Install Artisan L12 per the manufacturers approved details.

State of Florida  
C.O.A.  
# 28778

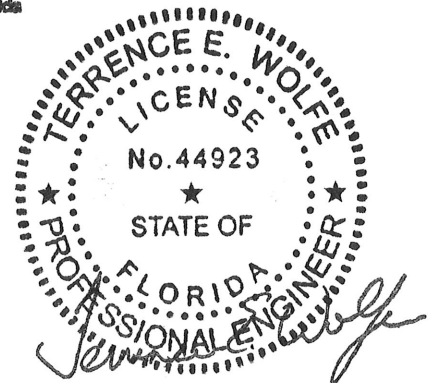

MAR 30 2015

State of Florida  
C.O.A.  
# 26776

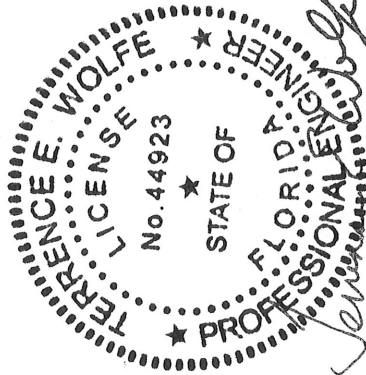

MAR 30 2015

Min. 16 ga. Member

